



CL-CM2002

Loss Factors Methodology and Disclosure

Issue Version Number: 3.0

Data Classification: Public

Published Date: 30/01/2023

Next Review Due: 30/01/2024

©2023 Centralines Limited

This is an approved controlled document and is subject to change.

Please ensure you have the most up-to-date copy at all times.

Contact the Document Owner for the latest version.

CL-CM2002 Loss Factors Methodology and Disclosure

Overview

Document status

Draft **In Service** Under Review Archived

Document purpose

This document outlines the methodology for the evaluation, allocation and apportionment of loss factors.

Intended audience

This is a public disclosure document, required under industry agreements such as the:

- Electricity Industry Participation Code, and
- Use of System or Default Distributor Agreements.

Document contributors

Contributors	Name and Position Title	Approval Date
Creator	Henk Potgieter Network Analysis and Solutions Engineer	15/12/2022
Authoriser	Jason Larkin General Manager (Centralines) & Commercial Manager	20/12/2022
Approver	Jaun Park Chief Operating Officer	30/01/2023

Key dates

Published Date 30/01/2023

Next Review Date 30/01/2024

Renewal period – Yearly

Related references

Legislation

- Electricity Industry Participation Code 2010

Centralines Policy

- CL-CM0002 Pricing Policy and Schedules

Other Reference

- Electricity Authority Guidelines on the Calculation and the Use of the Loss Factors for Reconciliation Purposes 2018

Overview

Content

This document contains the following topics:

Topic	See Page
1. Definitions/Abbreviations.....	4
2. Introduction	7
3. Centralines' Network Disaggregation	8
4. Methodology	11
Appendix A – Loss Factors.....	15
Appendix B – Summary of Document Changes.....	16

1. Definitions/Abbreviations

Code For the purpose of this document refers to the Electricity Industry Participation Code 2010.

EA Guidelines For the purpose of this document refers to the guidelines on the calculation and use of loss factors for reconciliation purposes, published by the Electricity Authority in June 2018.

EMS Energy Market Services – a commercial business group of Transpower that provides metering services at Grid Exit Points (GXP). It monitors electricity flows and power quality at national grid connections to distribution networks and industrial sites.

GR250 GR250 Distributor Report – Electricity Traded – is the report defined in the Registry Functional Specification that details:

- loss-adjusted half-hour generation information, and
- ICP days (scaled loss-adjusted UFE inclusive balanced half-hour consumption).

Grid The National Grid is the network of high-voltage power lines operated by Transpower.

GXP Grid Exit Point – any point of connection between Transpower’s transmission system and the distributor’s network.

LF Loss Factor – a ratio expressed as a decimal number. It is used as a multiplier to be applied to the volume of energy measured at a Point of Connection (POC) within a network study area. This multiplier is used to scale the volume to account for the attributed technical or reconciliation loss relevant to that POC.

Load loss The loss of electricity, primarily in the form of heat, as:

- electricity is injected or consumed from the network, and
- current flows through network components which have electrical resistance.

Loss code Distributors are required by the Code to assign every point of connection a loss code and associated loss factors.

Definitions/Abbreviations

No load loss	<p>The electricity loss arising from the energy consumption necessary to energise the:</p> <ul style="list-style-type: none">• zone substation• distribution transformers• voltage regulators• auto transformers, and• isolating transformers.
NSP	<p>Network Supply Point – the point of connection at which a supply of electricity may flow between the distribution network and the embedded generators.</p>
NTLF	<p>Non-Technical Loss Factor – a ratio expressed as a decimal number that represents electrical losses arising from inaccuracies in measurement and data handling processes. These can arise from:</p> <ul style="list-style-type: none">• metering and meter reading errors• inaccurate metering installations• theft, and/or• unread meters. <p>It is calculated as the difference between Reconciliation Loss (RL) and Technical Loss (TL).</p>
POC	<p>Point of Connection – the point where electricity may flow between the network and the consumer’s installation and to which an ICP is allocated.</p>
PowerFactory	<p>DigSILENT PowerFactory – a software package that supports electricity load flow and contingency analysis.</p>
Reconciliation Manager	<p>The electricity market service provider who is for the time being appointed as the Reconciliation Manager.</p>
Retailer	<p>An Electricity Retailer – the company that supplies electricity to consumers with installations connected to the distributor’s network.</p>

Definitions/Abbreviations

RL Reconciliation Loss – the difference (as reported by traders to the Reconciliation Manager) between energy:

- injected into the network study area, and
 - delivered to the points of connection within that network study area.
-

RLF Reconciliation Loss Factor – the multiplier to be applied to the volume of energy measured at a Point of Connection (POC) within a network study area. This is used to scale the volume to account for the attributed Reconciliation Loss (RL) relevant to that POC.

SCADA Supervisory Control and Data Acquisition – a system that operates with coded signals over the network to provide control of remote equipment. SCADA allows Centralines' entire electrical network to be monitored and operated from Unison's Network Operations Centre.

TL Technical Loss – a loss resulting from load losses and no load losses between the parent Network Supply Point (NSP) and the Point of Connection (POC). Technical losses in the context of this document are calculated through network simulation.

TLF Technical Loss Factor – a multiplier to be applied to the electricity delivered or injected at a Point of Connection (POC) within a network study area to scale the volume to account for attributed Technical Loss (TL) between that POC and the parent Network Supply Point (NSP).

UFE Unaccounted for Electricity – calculated from the difference between:

- reported energy injected into a network, and
- the reported energy extracted from the network after it has been adjusted for losses.

2. Introduction

2.1 Background

As electricity travels through an electrical network, a portion is lost due to a variety of factors. These can include electrical energy converted to heat due to network internal resistance. Electricity losses influence the cost of electricity for all consumers and are apportioned to consumers based on the calculation of loss code loss factors.

The Electricity Participation Code 2010 requires Centralines to publish its loss codes and associated loss factors. This ensures that:

- pricing remains transparent to all consumers, and
 - Centralines is committed to minimising such losses.
-

2.2 Losses

Losses on an electrical network can be categorised as follows:

- Technical losses which include:
 - load losses – these vary with the amount of electricity distributed. These losses arise from the heating effects due to resistance in network assets, and
 - no load losses – these are not affected by the magnitude of current. These losses take the form of heat and noise and occur while transformers or zone substations are energised
 - Non-technical losses such as:
 - theft
 - metering inaccuracies, and
 - data handling errors
 - Reconciliation losses – the combination of technical and non-technical losses, and
 - Unaccounted for Electricity (UFE) – the calculated difference between:
 - reported energy injected into the network, and
 - reported energy extracted from the network after it has been adjusted for losses.
-

3. Centralines' Network Disaggregation

3.1 Centralines network

Figure 1 shows the typical structure of Centralines' network with points of energy metering shown for various consumers. From this figure, the points of metering are also the points of connection (POC).

The connection points for some low voltage (LV) consumers occur downstream after non-Centralines-owned LV conductors. These conductors are classed as service mains and the losses incurred along these are accounted for in the loss evaluation.

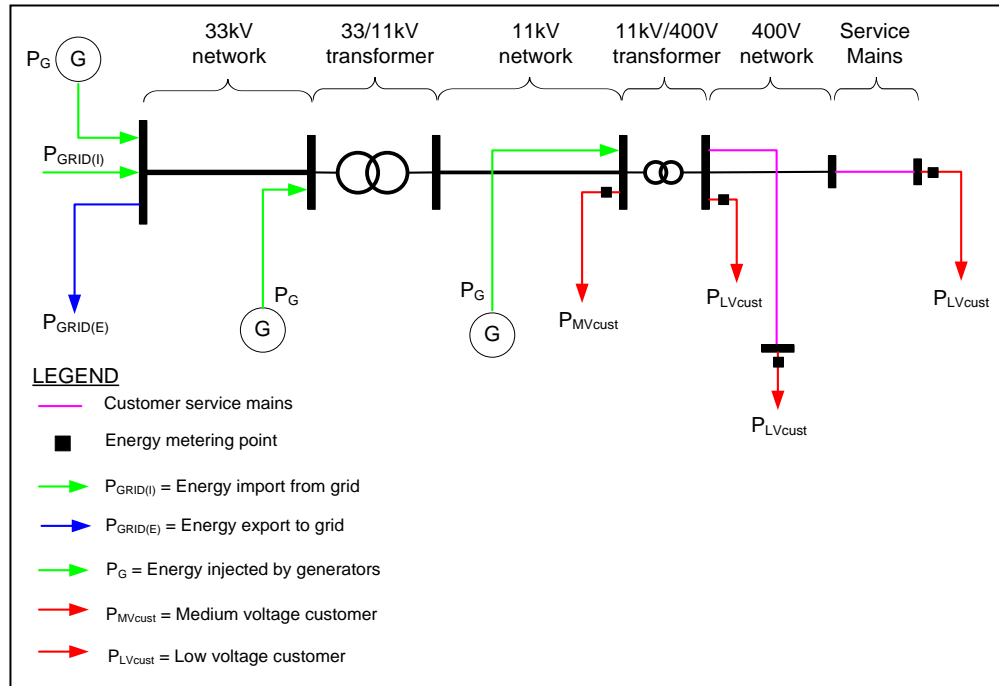


Figure 1 – Typical Structure of Centralines' Distribution Network

Centralines' Network Disaggregation

3.2 Method

Centralines separates its network into network study areas and network segments, as recommended in the Electricity Authority Guidelines on the calculation and use of loss factors for reconciliation purposes (EA Guidelines).

3.2.1 Network Study Areas

Centralines has one Grid Exit Point (GXP) servicing the network area.

GXP	Identifier
33kV Waipawa	WPW0331

Table 1 – Grid Exit Point Identifier

3.2.2 Network Segments

The network area is divided into three network segments (as shown in Table 2) representing the three levels of voltage reticulation on Centralines' network.

Network Segment	Included for Loss Allocation Purposes
33kV Network	<ul style="list-style-type: none"> • 33kV lines and cables • 33kV switches
11kV Network	<ul style="list-style-type: none"> • 11kV lines and cables • 11kV switches • Load and no-load loss of the 33/11kV zone substation transformers
LV (400V) Network	<ul style="list-style-type: none"> • LV network representation • LV switches • Load and no load loss of the 11kV/LV distribution transformers

Table 2 – Network Segments

Centralines' Network Disaggregation

3.3 Loss codes and factors

Loss codes are created for each connection point on the network based on the:

- network region
- network segment it belongs to (voltage-level it connects to)
- type of connection (load or/and generation), and
- size of the connection.

A loss factor (LF) is calculated for each loss code based on the losses allocated to each loss code.

Site specific studies, with dedicated loss codes are completed for:

- embedded generating stations with a nameplate capacity of 10MW or more
- interconnection points with other electricity distributors, and
- distinct consumer connections (at Centralines' discretion) for the purpose of losses allocation.

Centralines' loss codes, including their description and loss factors for consumption and generation are provided in *Appendix A – Loss Factors*.

4. Methodology

4.1 Overview of approach

The purpose of this methodology is to:

- ensure compliance with the Code
 - ensure Centralines meets its obligations under the Use of System and/or Default Distributor Agreements
 - account for losses on the Centralines' network, and
 - enable Centralines to allocate losses to loss codes in a robust, consistent and fair manner.
-

4.2 Loss calculation

4.2.1 Reconciliation Loss (RL)

Reconciliation losses are calculated for network study areas by combining the data recorded at the GXP and reported via the:

- Energy Market Services (EMS), and
- GR250 Distributor Report – Electricity Traded file (supplied by the Reconciliation Manager).

The GR250 data is converted to pre-loss values using the reported loss codes and defined reconciliation loss factors (RLFs) for the period.

$$GR250_{PreLoss} = GR250_{IncludingLoss} / RLF$$

The reconciliation losses are calculated as follows:

$$RL = |EMS_x| + |GR250_I| - |EMS_I| - |GR250_x|$$

where:	$EMS_I =$	the absolute value of the EMS kWh values marked as Injected
	$EMS_x =$	the absolute value of the EMS kWh values marked as Exit
	$GR250_I =$	the absolute value of the pre-loss GR250 kWh values marked as Injected
	$GR250_x =$	the absolute value of the GR250 kWh values marked as Exit

Methodology

4.2 Loss calculation (cont)

4.2.2 Technical Loss (TL)

The network study area and network segment technical losses are calculated through the:

- simulation of Centralines' network for normal network configuration under peak load
- identification of annual peak loads from Centralines' SCADA data
- identification of losses introduced by generation through the incremental method defined in the EA Guidelines, and
- application of load loss factors, as calculated from Centralines' SCADA data.

Accuracy factors include:

- allocation of load in the network model
- load diversity allocation
- limited SCADA data
- completeness of network models
- use of the incremental method for generators, and
- the use of typical impedances in network models.

4.2.3 Non-Technical Loss (NTL)

Non-technical losses are the difference between the reconciliation losses and technical losses allocated and expressed as:

$$NTL = RL - TL$$

Methodology

4.3 Loss apportionment

Losses are allocated so the equation below remains true:

$$RL_{Study\ Area} = \sum_{n=1}^k (LRLF_n - 1) \cdot LE_n - \sum_{n=1}^k (GRLF_n - 1) \cdot GE_n$$

- where:
- RL_{Study Area} = Reconciliation Loss of Study Area
 - LRLF_n = Reconciliation Loss Factor of Loss Category Code n when consuming energy from the grid
 - LE_n = Energy consumed by Loss Category Code n over the period
 - GRLF_n = Reconciliation Loss Factor of Loss Category Code n when supplying energy to the grid
 - GE_n = Energy supplied by Loss Category Code n over the period
 - k = Number of Loss Category Codes

4.3.1 Technical Loss

Technical losses are apportioned to loss codes using one of the following methods:

- Pro-rata method – based on peak demand for consumption Loss Factor calculations
- Incremental method – based on low, medium and high load and generation scenarios for generation Loss Factor calculations, or
- I²R calculation – for a dedicated point to point connection for either consumption or generation Loss Factor calculations.

4.3.2 Reconciliation Loss

Reconciliation losses are apportioned so the ratio of the loss code technical losses to the study area technical losses

is equal to

the ratio of the loss code reconciliation losses to the study area reconciliation losses.

This is expressed in the equation below.

$$= \frac{(Loss\ Code\ allocated\ TL/Network\ Study\ Area\ TL)}{(Loss\ Code\ allocated\ RL/Network\ Study\ Area\ RL)}$$

Methodology

4.4 Loss factor calculation

Loss factors for loss codes are calculated using the equation expressed below:

$$LF = \frac{(Volume Consumed or Generated [kWh] + Allocated Loss [kWh])}{(Volume Consumed or Generated [kWh])}$$

Where a consumption loss factor greater than one represents an increase in network losses, and a generation loss factor of greater than one represents a decrease in network losses.

Appendix A – Loss Factors

Loss factors Table 3 outlines the individual TLF, NTLF and RLF for the information disclosure.

Loss Code	Description	Energy Type	TLF	NTLF	RLF
LFCH001	LV Metering Centralines	Load	1.0459	1.0496	1.0956
LFCH002	Ovation New Zealand Limited	Load	1.0272	1.0294	1.0567
LFCH003	Silver Fern Farms Limited	Load	1.0234	1.0253	1.0487
LFCH004	Nochi Trust - Ngaruru Station	Generate	1.0000	1.0000	1.0000
LFCH004	Nochi Trust - Ngaruru Station	Load	1	1	1

Table 3 – Centralines' Submission Loss Factors

Appendix B – Summary of Document Changes

Date	Version No.	Changes to Document	Creator	Authoriser	Approver
10/12/2020	1.0	New Standard. Methodology aligned with EA guidelines.	Network Analysis Solutions Engineer and	General Manager (Centralines) & Commercial Manager	General Manager Networks and Operations
21/12/2021	2.0	Full review. Information still relevant. Appendix A – loss code LFCH004 added.	Network Analysis Solutions Engineer and	General Manager (Centralines) & Commercial Manager	General Manager Networks and Operations
30/01/2023	3.0	Full review. Updated formulas	Network Analysis Solutions Engineer and	General Manager (Centralines) & Commercial Manager	Chief Operating Officer